
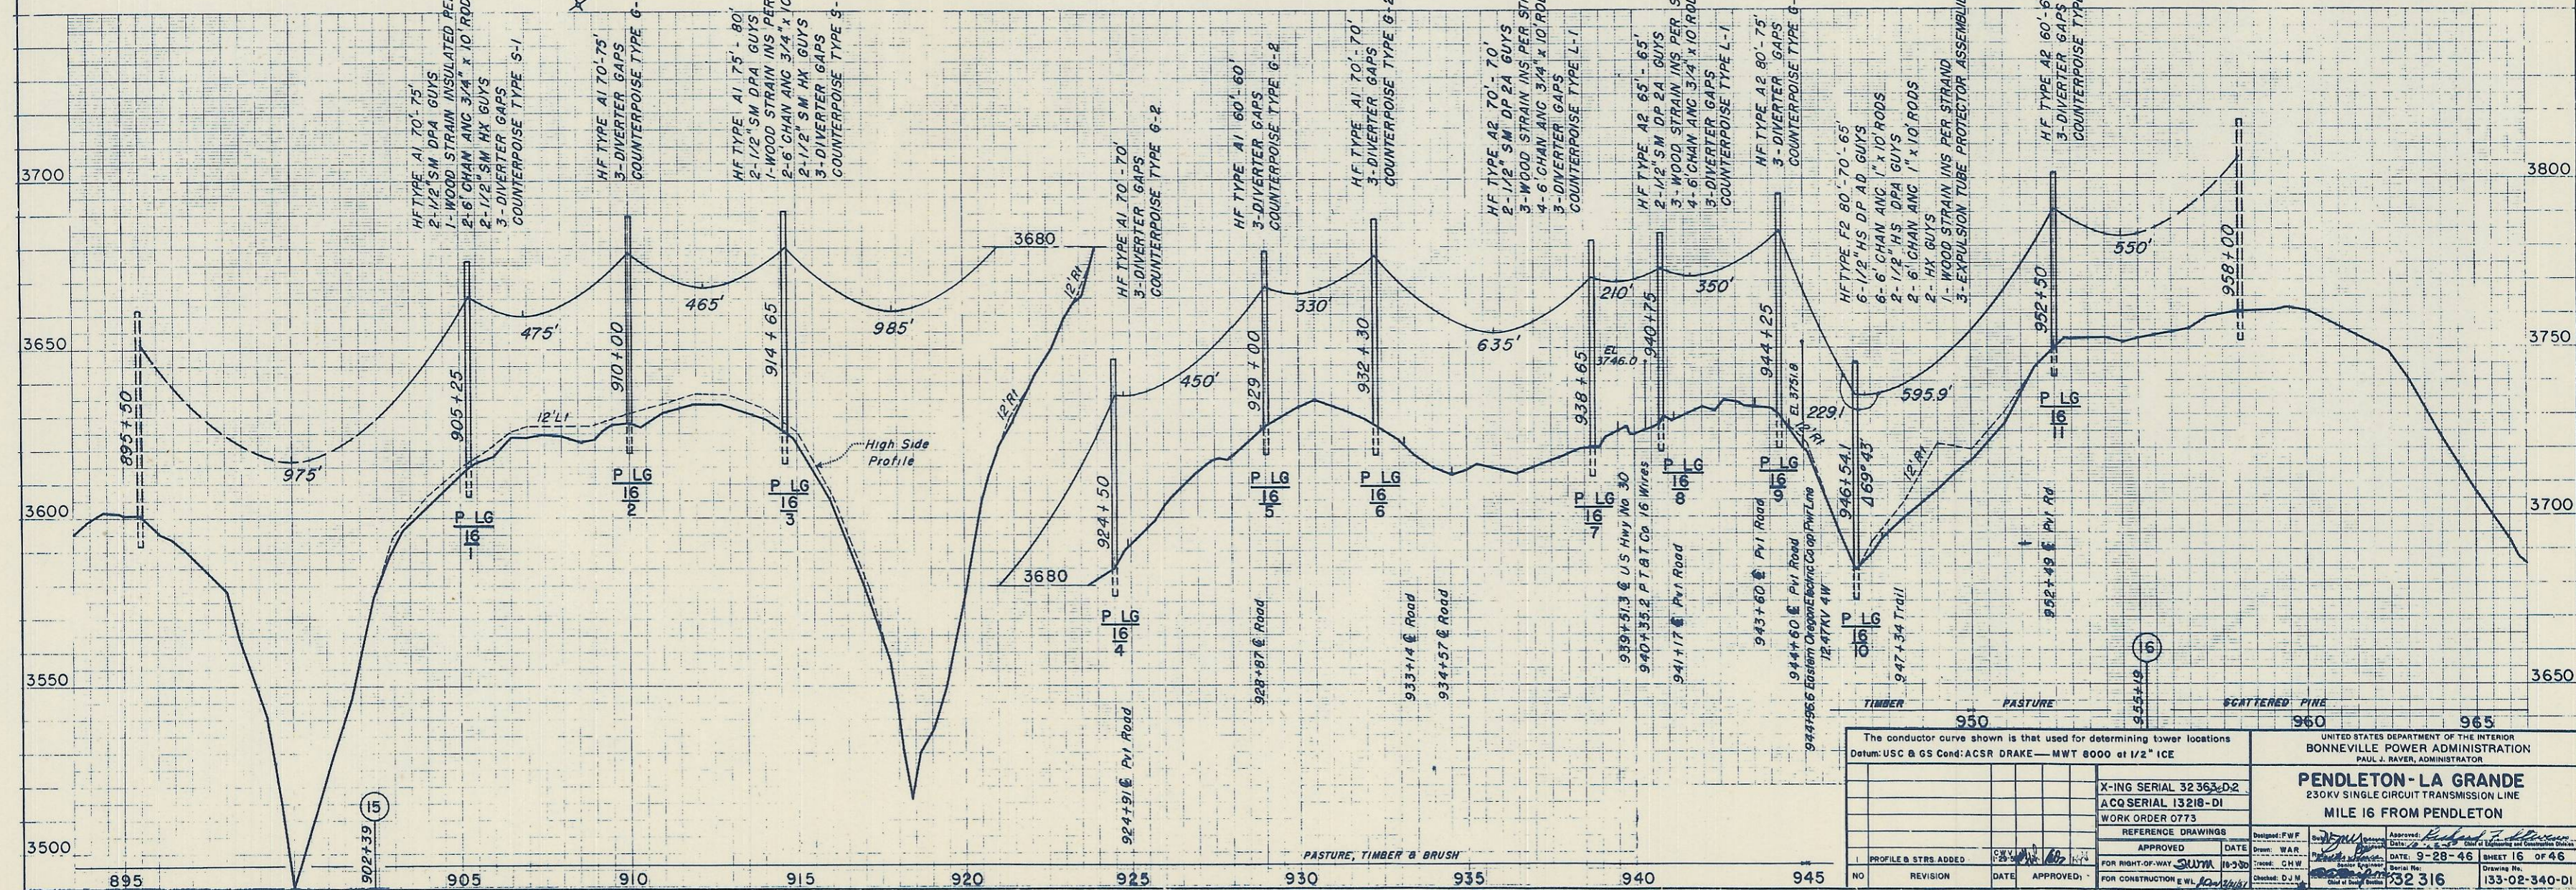


FOR OWNERSHIP DATA SEE
DRAWING SERIAL 13218

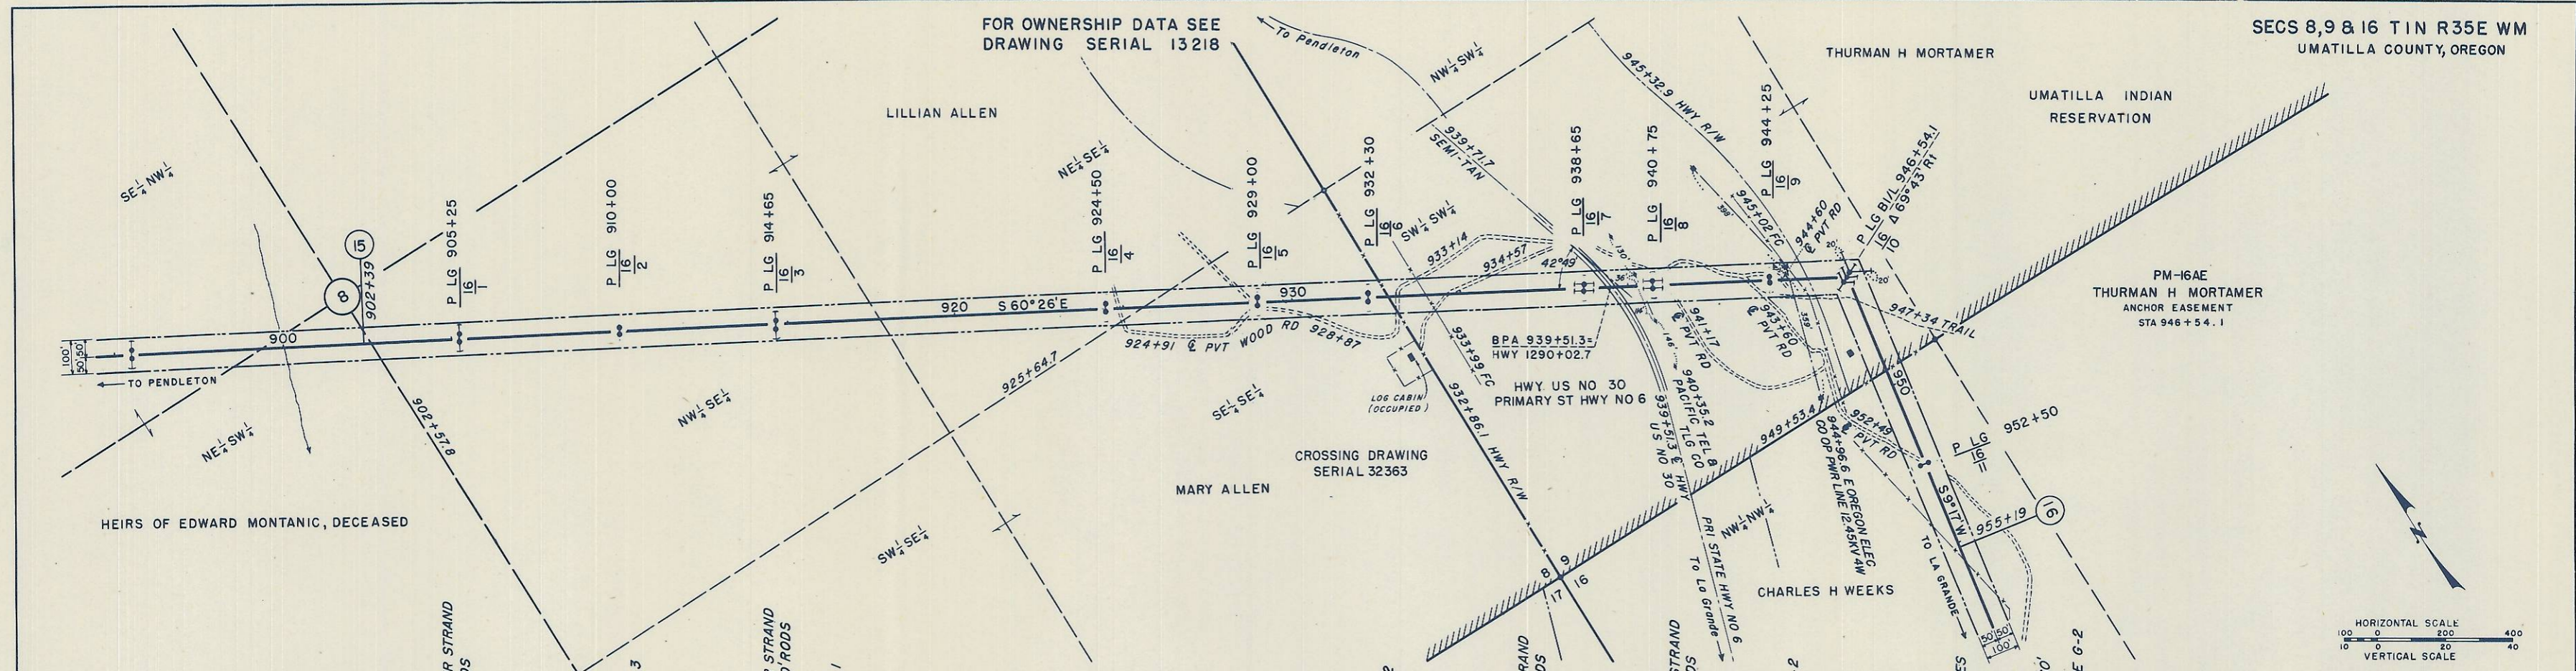

The conductor curve shown is that used for determining tower locations Datum: USC & GS Cond: ACSR DRAKE — MWT 8000 at 1/2" ICE		UNITED STATES DEPARTMENT OF THE INTERIOR BONNEVILLE POWER ADMINISTRATION PAUL J. RAVER, ADMINISTRATOR	
X-ING SERIAL 32363-D-2 ACQ SERIAL 13218-DI WORK ORDER 0773		PENDLETON-LA GRANDE 230KV SINGLE CIRCUIT TRANSMISSION LINE MILE 16 FROM PENDLETON	
REFERENCE DRAWINGS APPROVED DATE FOR RIGHT-OF-WAY SWM 11-30 FOR CONSTRUCTION g.w. 11-30		Design: P.W.F. Drawn: W.A.R. Checked: C.H.W. Date: 9-28-46 Sheet 16 of 46 Drawing No. 133-02-340-DI	
NO	REVISION	DATE	APPROVED
1	PROFILE & STRS ADDED	11-30	C.H.W.