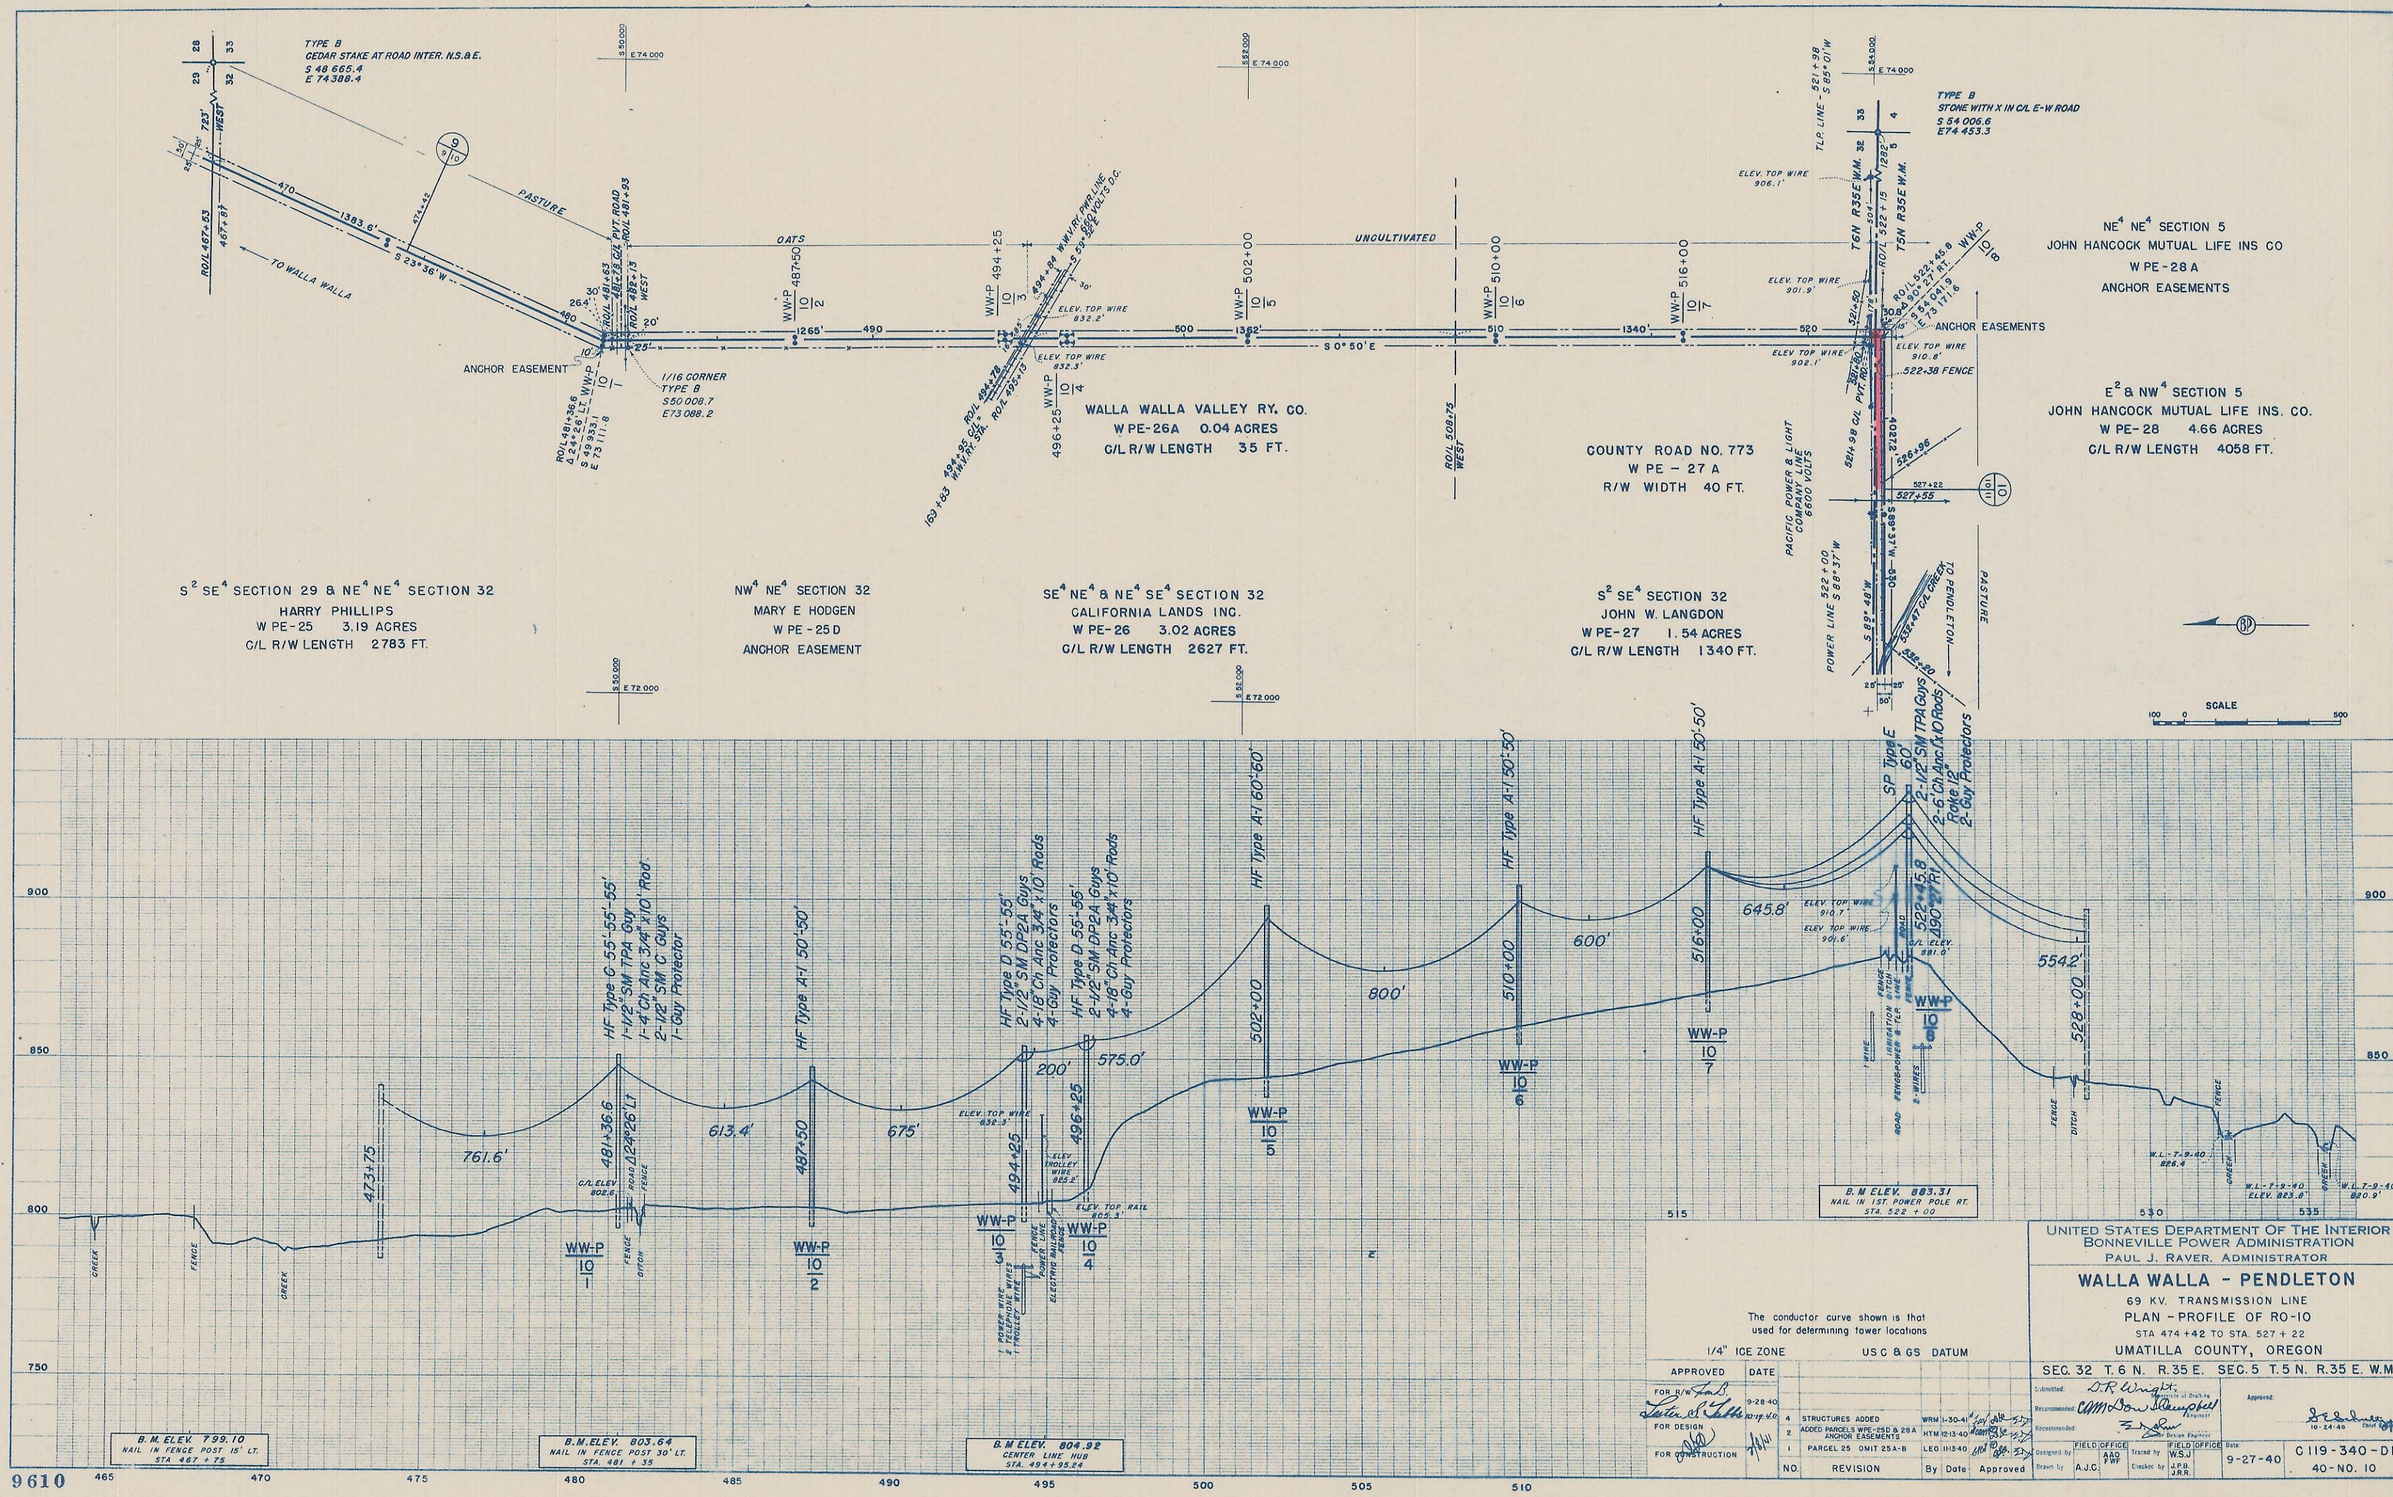

The conductor curve shown is that used for determining tower locations

1/4" ICE ZONE USC & GS DATUM

APPROVED	DATE
FOR R/W	9-28-40
FOR DESIGN	10-19-40
FOR CONSTRUCTION	7/8/41

NO.	REVISION	By	Date	Approved
4	STRUCTURES ADDED	WRM	1-30-41	
2	ADDED PARCELS WPE-25D & 28A ANCHOR EASEMENTS	HTM	12-13-40	
1	PARCEL 25 OMIT 25A-B	LEO	11-13-40	

UNITED STATES DEPARTMENT OF THE INTERIOR
BONNEVILLE POWER ADMINISTRATION
PAUL J. RAVER, ADMINISTRATOR

WALLA WALLA - PENDLETON

69 KV. TRANSMISSION LINE
PLAN - PROFILE OF RO-10
STA 474 + 42 TO STA. 527 + 22
UMATILLA COUNTY, OREGON

SEC. 32 T. 6 N. R. 35 E. SEC. 5 T. 5 N. R. 35 E. W.M.

Submitted: D.R. Wright, Assistant of Drafting
Recommended: C.M. Don Campbell, Engineer
Recommended: Chief Design Engineer
Approved: 10-24-40 Chief Engineer

Designed by	FIELD OFFICE	Traced by	FIELD OFFICE	Date	
Drawn by	A.J.C. AAO FWF	Checked by	W.S.J. J.P.B. J.R.R.	9-27-40	C 119-340-D1 40-NO. 10

9610