


FOR PROFILE SEE DRAWING SERIAL 51129A

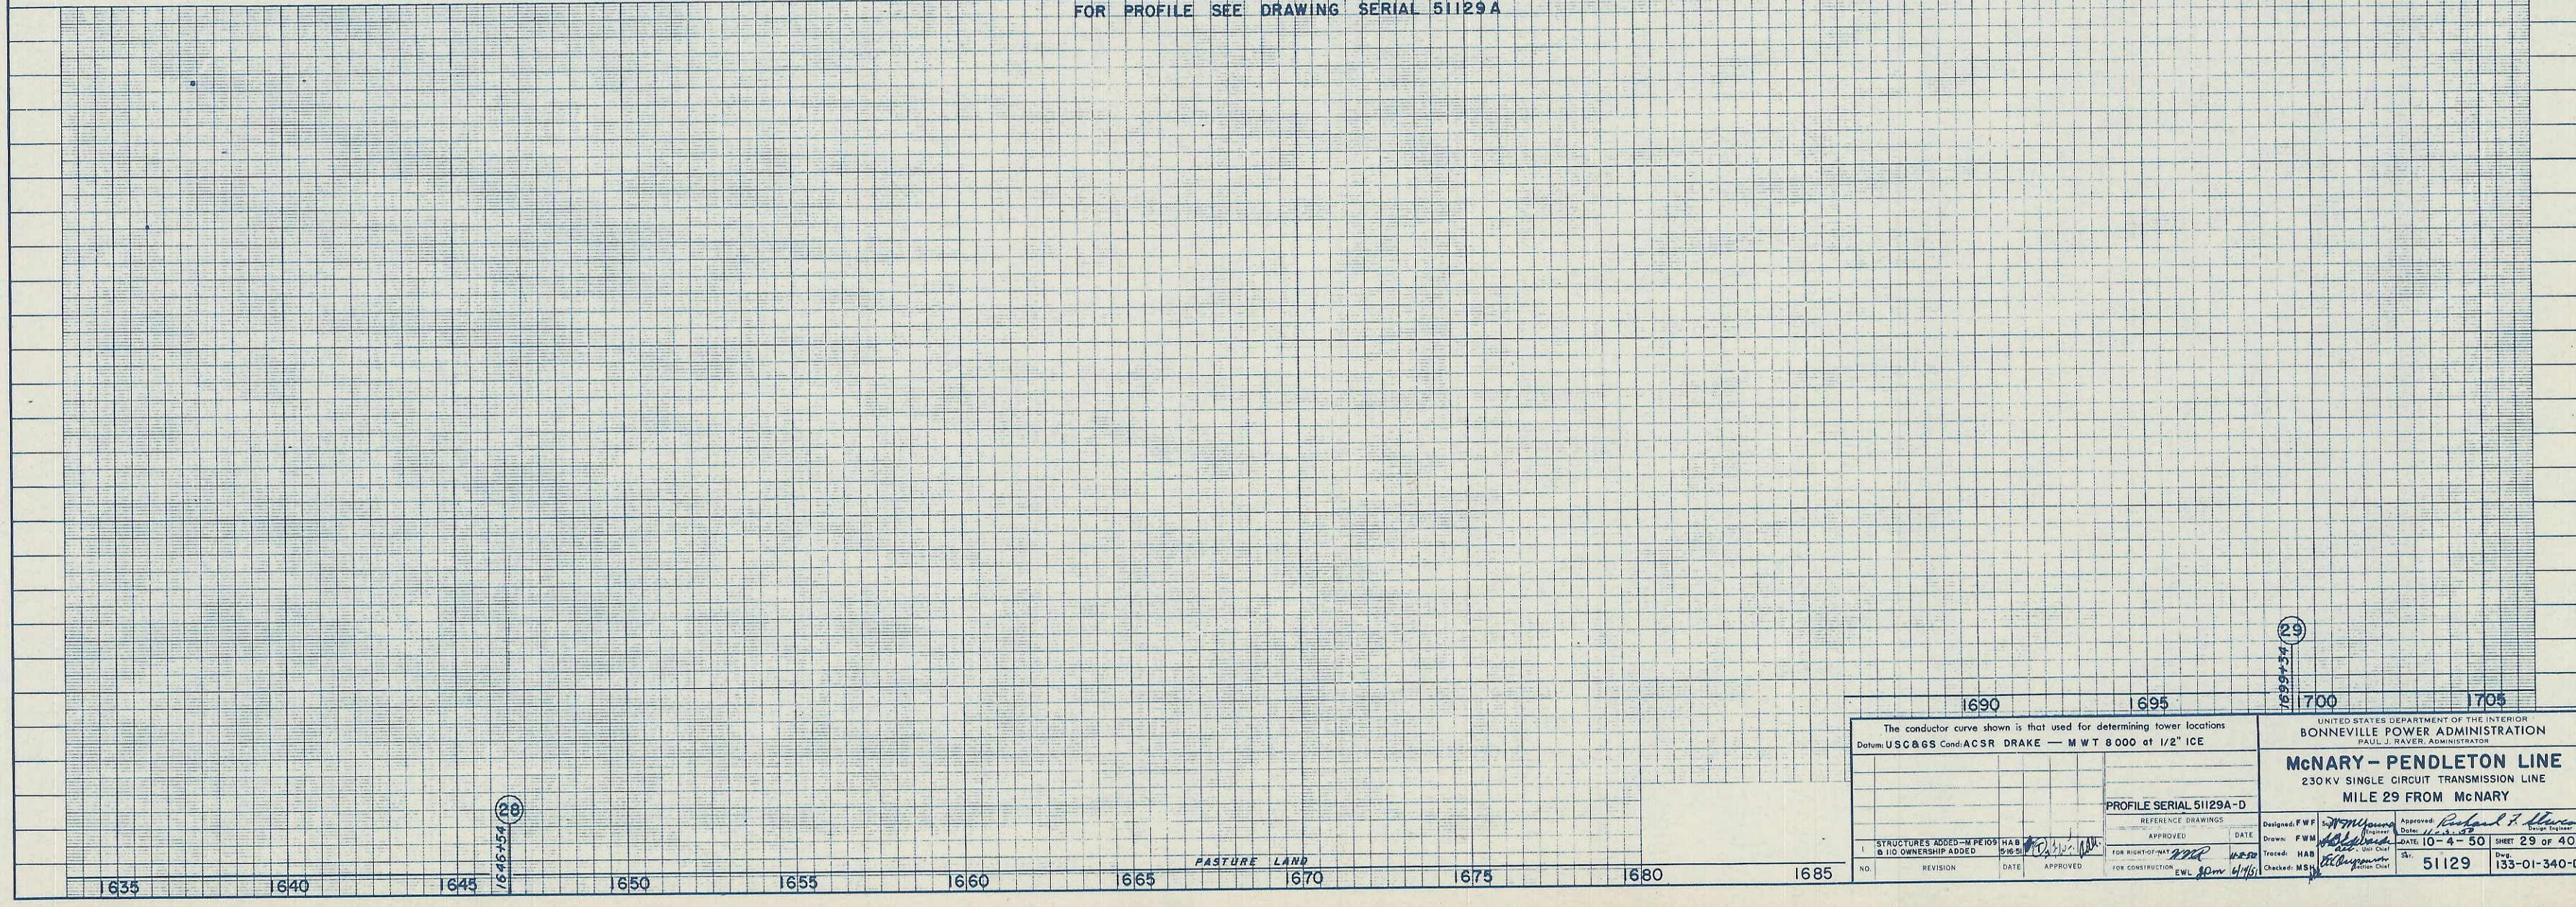

The conductor curve shown is that used for determining tower locations Datum: USC & GS Cond: ACSR DRAKE — MWT 8 000 at 1/2" ICE		UNITED STATES DEPARTMENT OF THE INTERIOR BONNEVILLE POWER ADMINISTRATION PAUL J. RAVER, ADMINISTRATOR	
STRUCTURES ADDED — M PE 108 H A B B 110 OWNERSHIP ADDED 10-4-50		PROFILE SERIAL 51129A-D APPROVED: [Signature] DATE: 10-4-50 DESIGNED: F W F DRAWN: F W F CHECKED: H A B FOR CONSTRUCTION: E W L 10/4/50	
NO. REVISION DATE APPROVED		SHEET 29 OF 40 51129 133-01-340-01	